


PLAN

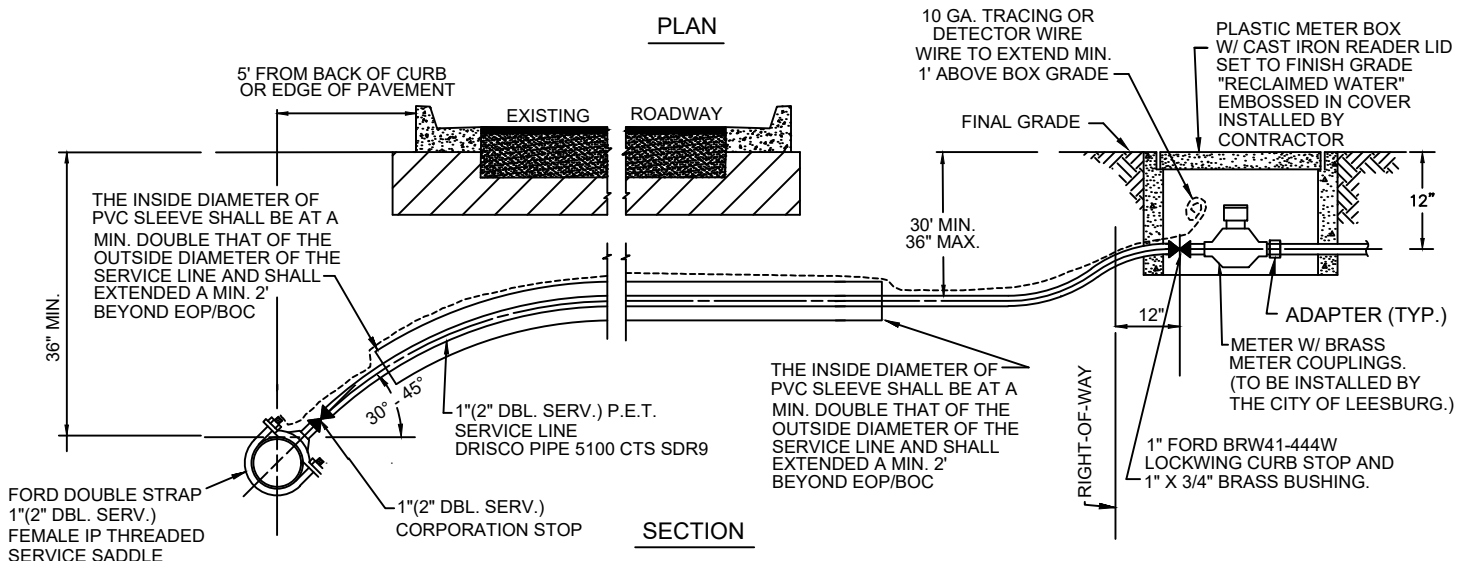

SECTION

REUSE WATER SERVICE CONNECTION DETAILS

NOT TO SCALE

- ** NOTE: 1. METERS TO BE INSTALLED BY CITY OF LEESBURG.
 2. SERVICE LINE DEFLECTIONS SHALL NOT EXCEED 75% OF THAT RECOMMENDED BY MANUFACTURER.
 3. METER BOXES TO BE INSTALLED BY CONTRACTOR DURING CONSTRUCTION.
 4. ALL FITTINGS TO BE CTS BRASS OR CITY OF LEESBURG APPROVED (NO LEAD)
 5. ALL SERVICES TO BE IN PROPERLY SIZED SLEEVES FOR ROAD CROSSING ON SANITARY SIDE OF LOT



LEESBURG
The Lakefront City

City of Leesburg Standard Details

2024

Detail R-3