

SPECIFICATIONS

***NOTE: VALVES SHALL BE PLACED ADJACENT TO MAIN, AND TIED TO TEE.**

1. AWWA SPECIFICATIONS C-502
2. TWO 2-1/2" HOSE NOZZLE DISCHARGE
3. ONE 4-1/2" PUMPER NOZZLE DISCHARGE
4. ONE 1-1/2" OPERATING NUT, LEFT

APPLY TWO COATS OF SHERMAN WILLIAMS OR EQUAL OSHA SAFETY INDUSTRIAL YELLOW PAINT TO HYDRANT BARREL.

APPLY TWO COATS OF SHERWIN WILLIAMS OR EQUAL OSHA SAFETY INDUSTRIAL ENAMEL PAINT TO THE BONNET AND NOZZLE CAPS. THE UTILITY DEPARTMENT INSPECTOR WILL DETERMINE THE COLOR TO PAINT THE HYDRANT BONNET AND NOZZLE CAPS BY FLOW TESTING HYDRANT.

5. HYDRANTS SHALL BE FLOW TESTED BY CONTRACTOR. COORDINATE WITH CITY ENGINEER FOR TESTING PROCEDURES.


6. ALL HYDRANTS SHALL BE EQUIPPED WITH GRADE-LOK FITTINGS TO ALLOW FOR ELEVATION ADJUSTMENTS.

** UNLESS AGREEMENT IS MADE WITH THE CITY OF LEESBURG WATER DEPARTMENT

7. ALL HYDRANTS SHALL BE :
- a. MUELLER CENTURION
 - b. CLOW MEDALLION
 - c. KENNEDY K81A
 - d. AMERICAN DARLING B-84-B (PREFERRED)

BLUE 1500 GPM OR MORE (SHERWIN WILLIAMS #SW4086) OR EQUAL
 GREEN 1000 GPM TO 1499 GPM (SHERWIN WILLIAMS #B54614) OR EQUAL
 ORANGE 500 GPM TO 999 GPM (SHERWIN WILLIAMS #B54E39) OR EQUAL
 RED 499 GPM OR LESS (SHERWIN WILLIAMS #B54R38) OR EQUAL
 YELLOW HYDRANT BARREL (SHERWIN WILLIAMS #B54Y37) OR EQUAL

*NOTE: All fire hydrants that have yet to be approved, or are out of service must be bag "Not in Service" or tagged "out of service". Tie straps shall be used to firmly secure Identification bags to hydrant.

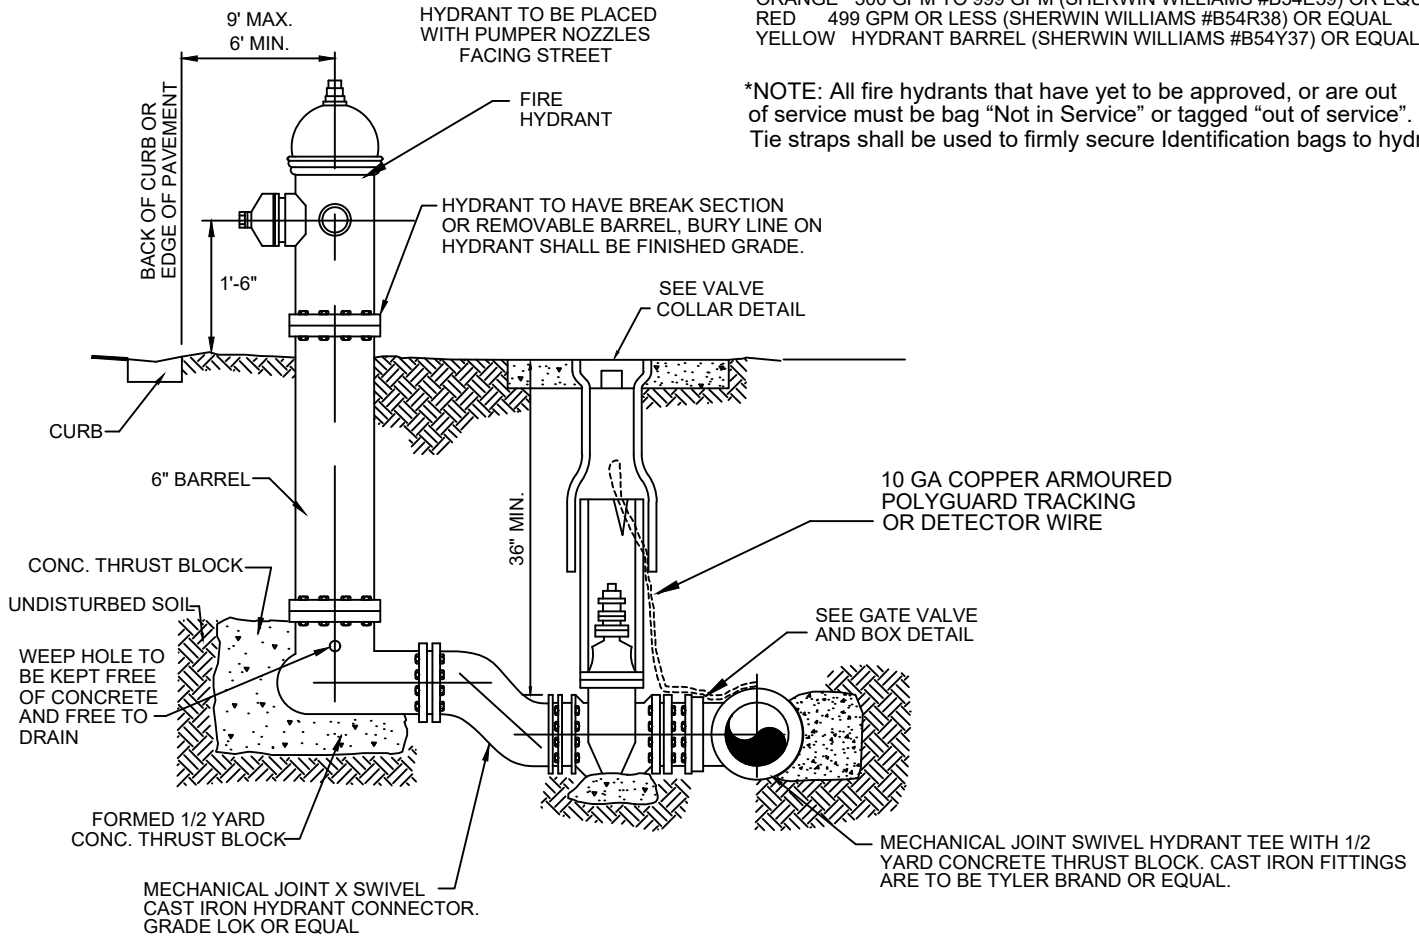

WATER FIRE HYDRANT WITH VALVE

NOT TO SCALE
(STANDARD FIRE HYDRANT ASSEMBLY)



LEESBURG

The Lakefront City

City of Leesburg Standard Details

2024

Detail W-11