


NOT TO SCALE

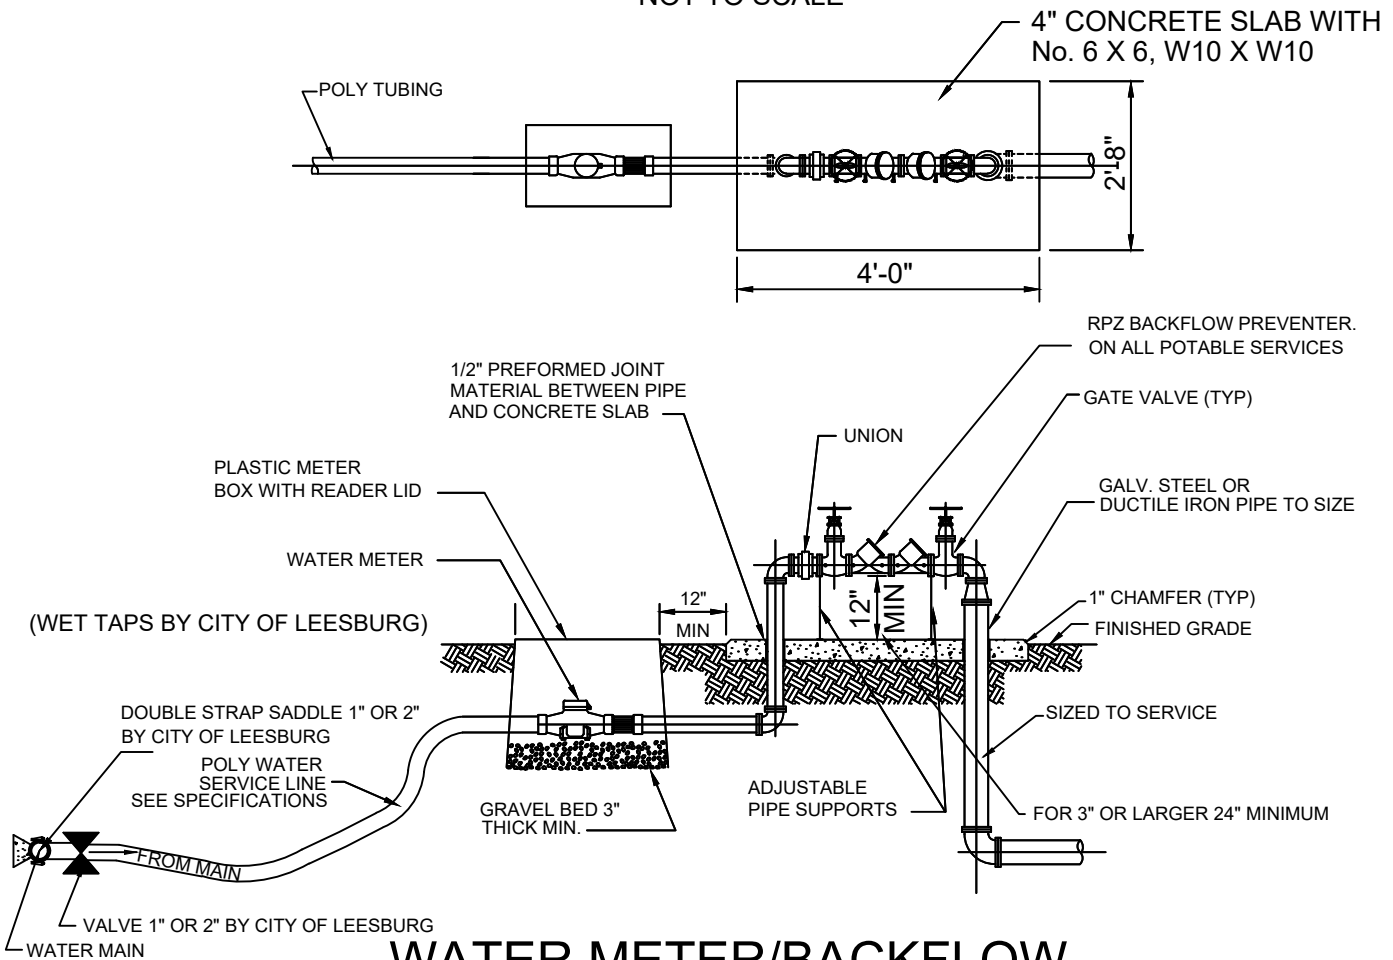

WATER METER/BACKFLOW

PREVENTER ASSEMBLY 3/4", 1" AND 2"

(3" METER AND LARGER SHALL BE INSTALLED ABOVE GROUND)

All Potable Water services connected to City of Leesburg Water are to be protected by a **Reduced Pressure Zone (RPZ) Backflow Prevention Device**. RPZ Backflow Prevention Device must be tested after installation and a copy of the test report must be submitted to the City of Leesburg Cross Connection division prior to the final CO home inspection.

All commercial services shall be equipped with a RPZ Backflow Prevention Device.

Where reuse water is available, all potable water connections shall be equipped with a RPZ Backflow Prevention Device.

** NOTE: 3/4" AND 1" USE 1" POLY TUBING. 2" USES 2" POLY TUBING. NO 2 1/2" SERVICES ARE ALLOWED
SEE CITY OF LEESBURG SPECIFICATIONS



LEESBURG
The Lakefront City

City of Leesburg
Standard Details

2024

Detail W-15