


**PLAN**

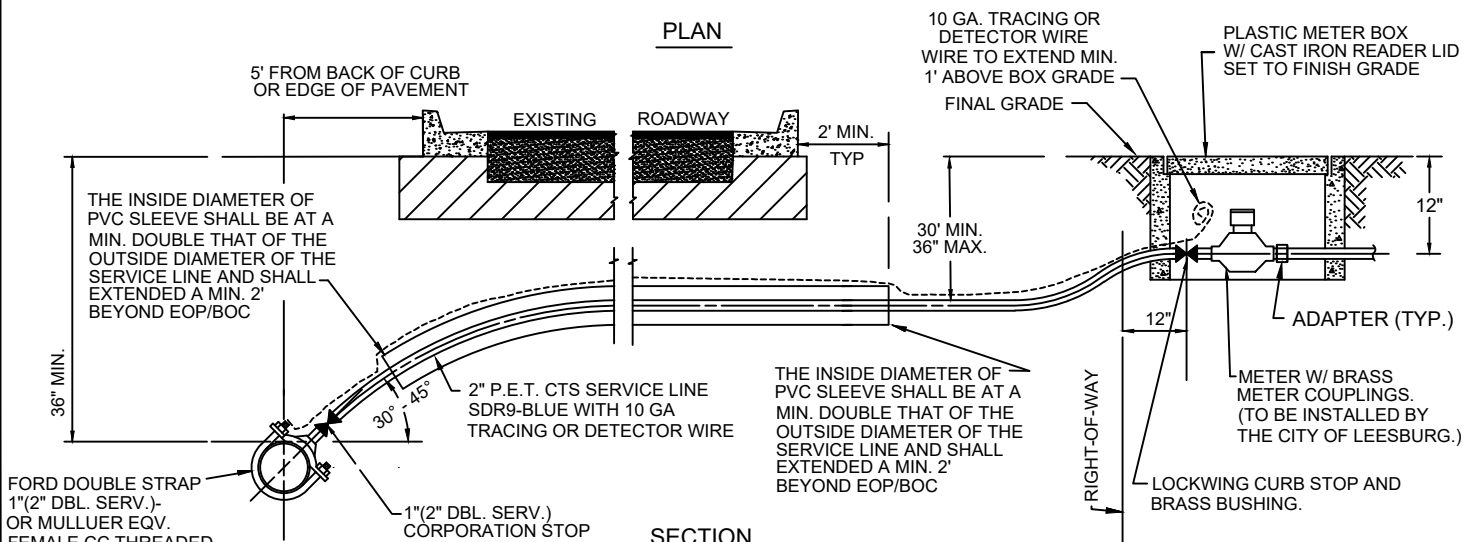

**SECTION**

**WATER SERVICE CONNECTION DETAILS**

NOT TO SCALE

**NOTES:**

1. METERS TO BE INSTALLED BY CITY OF LEESBURG.
2. SERVICE LINE DEFLECTIONS SHALL NOT EXCEED 75% OF THAT RECOMMENDED BY MANUFACTURE.
3. AS PER APPROVED CITY OF LEESBURG MUNICIPAL CODE 7-120(b). NO CONSUMER OF WATER SUPPLIED BY THE CITY SHALL HAVE A CROSS CONNECTION, EITHER INSIDE OR OUTSIDE OF ANY BUILDING OR STRUCTURE, WITHOUT FIRST INSTALLING AN APPROVED BACKFLOW PREVENTION DEVICE TO PREVENT ALL BACKFLOW INTO THE CITY WATER SYSTEM. SEE CITY OF LEESBURG BACKFLOW DETAIL W-15



**LEESBURG**  
The Lakefront City

**City of Leesburg**  
**Standard Details**

Revised 2024

Detail W-9